



# ELEKTROPRIJENOS BiH ЕЛЕКТРОПРЕНОС БИХ

Broj: JN-OP-466-12/2025

Datum: 09-09-2025

## **PREDMET:** Pojašnjenje tenderske dokumentacije

U sjedištu Ugovornog organa dana 05.09.2025. godine, pod brojem protokola: JN-OP-466-11/2025 zaprimljen je Zahtjev za pojašnjenje tenderske dokumentacije, broj: JN-OP-466-7/2025 u postupku javne nabave Rezervni dijelovi VN prekidača, dostavljen od strane privrednog subjekta NEXIS d.o.o. Sarajevo, u kome se traži sljedeće pojašnjenje:

Poštovani,

Pa ima samo jedna stavka za ovaj LOT 3.

Ugovorni organ u zakonski ostavljenom roku, shodno članu 56. stav (2) Zakona o javnim nabavkama ("Službeni glasnik Bosne i Hercegovine", br. 39/14, 59/22 i 50/24) daje odgovor sa pojašnjenjem kako slijedi:

1. Iz vašeg prethodnog upita nije bilo jasno na koji se LOT odnosio isti, jer taj podatak niste nigdje naveli. Po vašem pitanju za LOT 3, dostavljamo za Prilog 8 - Tehnički zahtjevi i specifikacije, sliku prekidača s natpisne pločice sa kompletnim podacima (Slika 1) i sliku špule isklopa sa kompletnim podacima (Slika 2).

| SIEMENS                                                   |        |                                       |
|-----------------------------------------------------------|--------|---------------------------------------|
| Type                                                      | 3AP2FI | Year of manufacturing/No. 03/35079202 |
|                                                           |        |                                       |
| Rated voltage $U_r$                                       |        | 420 kV                                |
| Rated lightning impulse withstand voltage $U_{li}$        |        | 1425 kV                               |
| Rated switching impulse withstand voltage $U_{si}$        |        | 1050 kV                               |
| Rated frequency $f_r$                                     |        | 50 Hz                                 |
| Rated normal current $I_r$                                |        | 2000 A                                |
| Rated short-circuit breaking current $I_{sc}$             |        | 40 kA                                 |
| Rated duration of short-circuit $t_{sc}$                  |        | 3 s                                   |
| DC component of the rated short-circuit breaking current  | 38     | %                                     |
| First-pole-to-clear factor $k_{ep}$                       |        | 1.3                                   |
| Rated line-charging breaking current $I_{lc}$             |        | 400 A                                 |
| Rated cable-charging breaking current $I_{cc}$            |        | 400 A                                 |
| Rated operating sequence                                  |        | o-0.3s-co-3min-co                     |
|                                                           |        |                                       |
| Rated pressure of SF <sub>6</sub> at +20°C (gauge)        |        | 6.0 bar                               |
| Mass of fluid for interruption / pole m                   |        | 12.9 kg                               |
| Mass / pole M                                             |        | 1790 kg                               |
| Temperature class                                         |        | -30...+45 °C                          |
|                                                           |        |                                       |
| Relevant standard with date of issue: IEC 62271-100, 2001 |        |                                       |

Slika 1 - Prekidač

"Elektroprenos Bosne i Hercegovine" a.d. Banja Luka IB: 4402369530009

78000 Banja Luka, Marije Bursać 7a,  
Tel. +387 51 246 500, Fax: +387 51 246 550

Operativna područja:  
Banja Luka, Sarajevo, Mostar i Tuzla

MB: 11001416


BR: 08-50.3.-01-4/06

Ministarstvo pravde BiH  
Sarajevo

Korisničke banke i brojevi računa

|                             |                  |
|-----------------------------|------------------|
| Nova Banka a.d.             | 5550070151342858 |
| UniCredit Bank a.d. B. Luka | 5510010003400849 |
| Raiffeisen Bank             | 1610450028020039 |
| Atos Bank a.d. Banja Luka   | 5672411000000702 |
| NLB Banka                   | 1320102011989379 |



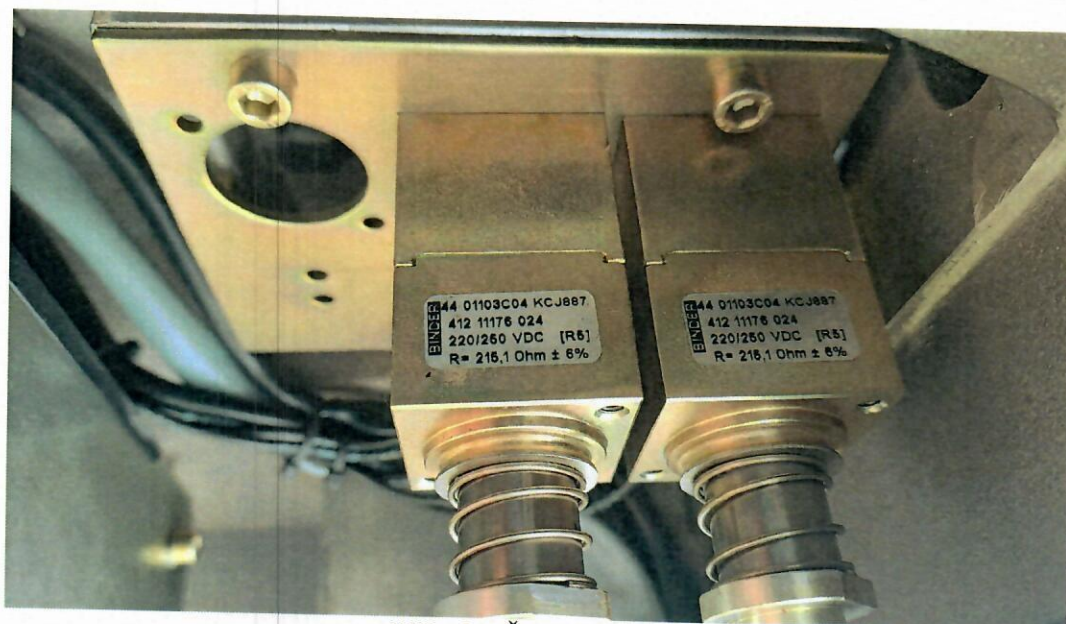

Slika 2 – Špula isklopa

S poštovanjem,

Predsjednika Komisije za  
JN-OP-466/2025

*Mirko Novak*

Mirko Novak mag. ing. el.