


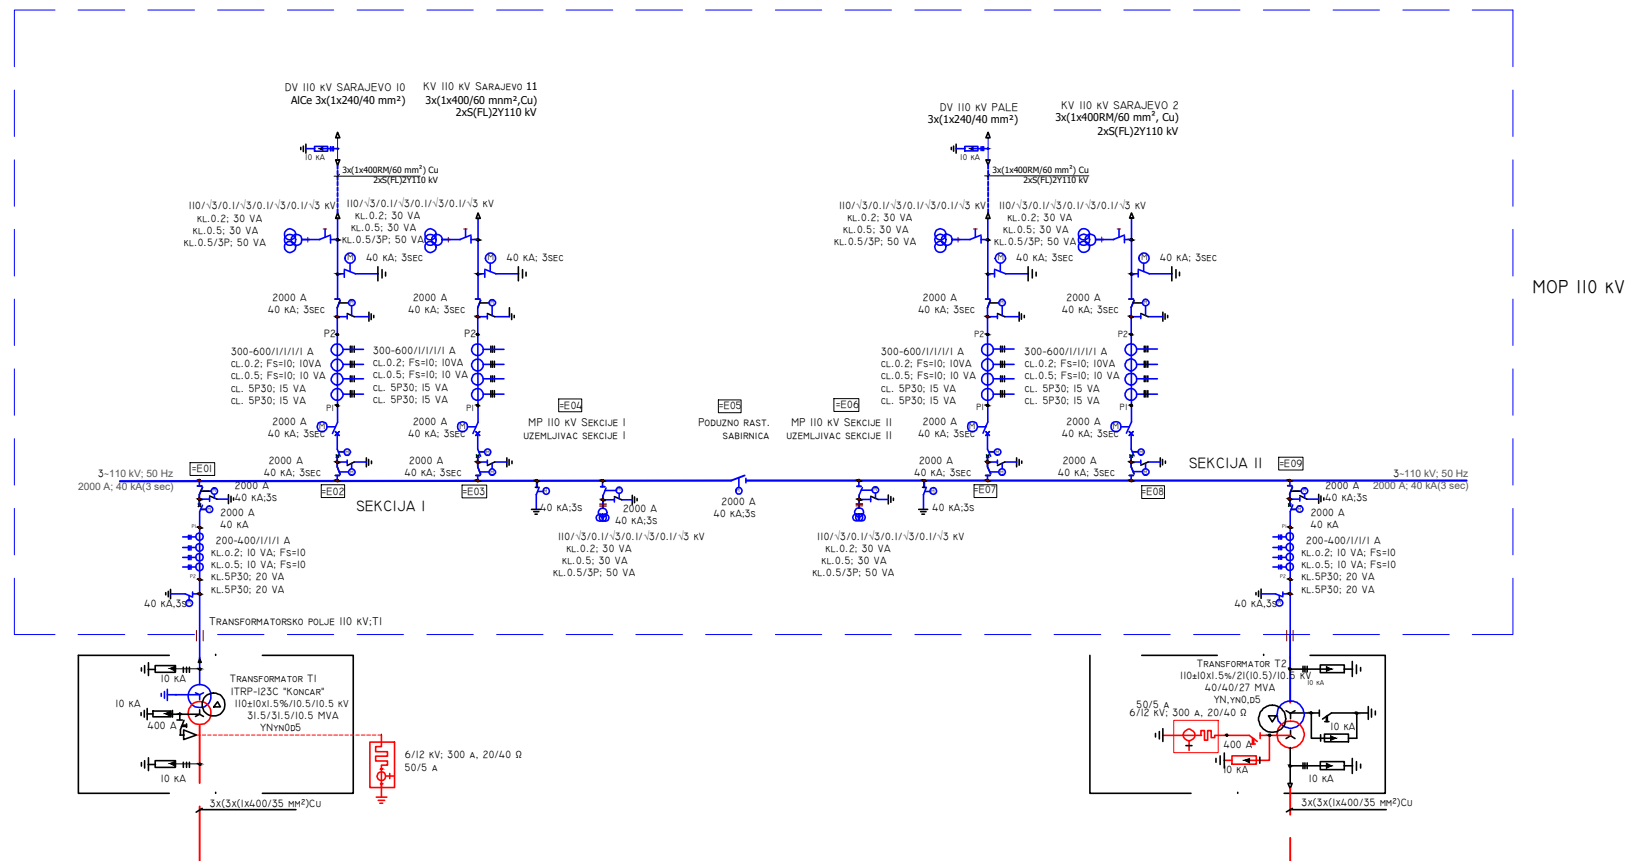

TS 110/20/10 kV SARAJEVO 5
REKONSTRUKCIJA TS
PROJEKTNI ZADATAK
JEDNOPOLNA SEMA
PRILOG BR. I